


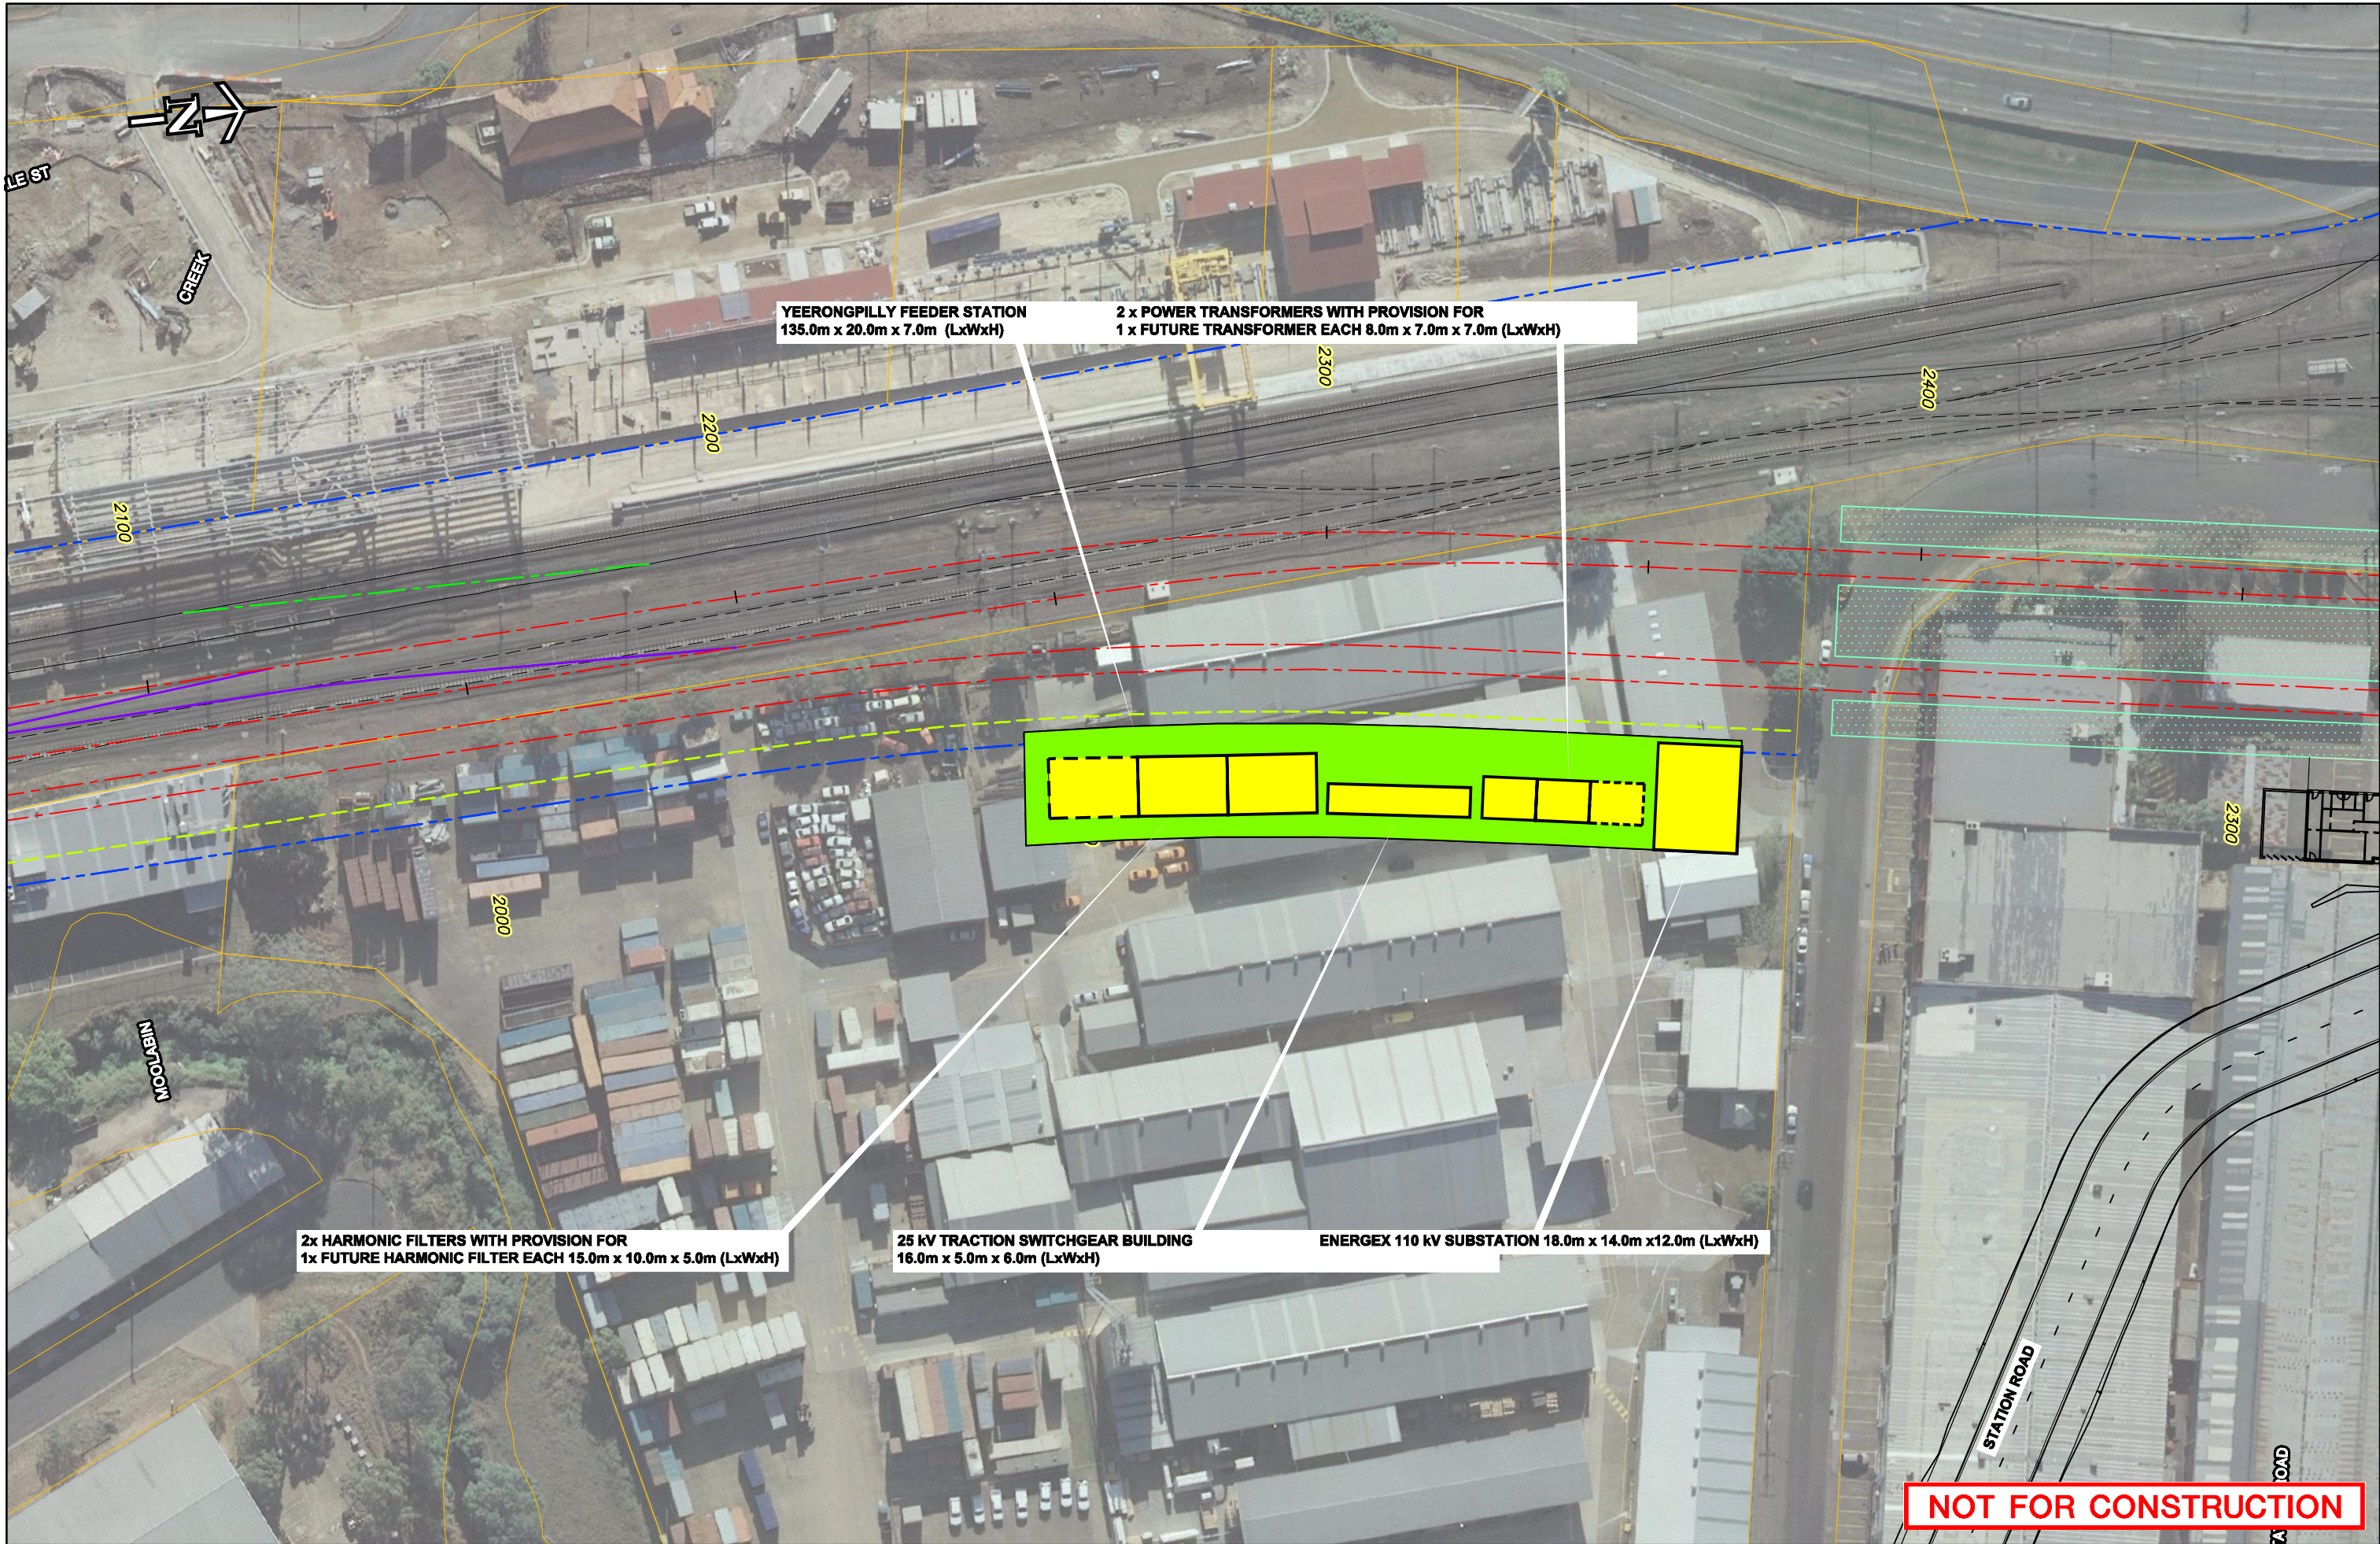

YEERONGPILLY FEEDER STATION
135.0m x 20.0m x 7.0m (LxWxH)


**2 x POWER TRANSFORMERS WITH PROVISION FOR
1 x FUTURE TRANSFORMER EACH 8.0m x 7.0m x 7.0m (LxWxH)**

**2x HARMONIC FILTERS WITH PROVISION FOR
1x FUTURE HARMONIC FILTER EACH 15.0m x 10.0m x 5.0m (LxWxH)**

25 kV TRACTION SWITCHGEAR BUILDING
16.0m x 5.0m x 6.0m (LxWxH)

ENERGEX 110 kV SUBSTATION 18.0m x 14.0m x12.0m (LxWxH)

This drawing is confidential and shall only be used for the purposes of this project.				
REVISIONS	No.	BY	DATE	DESCRIPTION
	C	13.05.11	UPDATED REFERENCE DESIGN	
				APPD

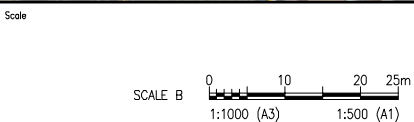

DISCLAIMER:
THIS DOCUMENT IS FOR THE PURPOSE OF BUSINESS CASE AND EIS DEVELOPMENT ONLY. THE DESIGN SHOWN ON THIS DRAWING IS CONSIDERED TO HAVE AN ACCURACY LEVEL APPROPRIATE FOR THE INTENDED PURPOSE OF THE REFERENCE DESIGN. THIS DOCUMENT USES DATA PROVIDED BY THIRD PARTIES WHICH HAS NOT BEEN INDEPENDENTLY VERIFIED. INFORMATION SHOULD BE REVIEWED DURING SUBSEQUENT PHASES OF THE PROJECT. ALL USE OF, OR RELIANCE UPON THIS DOCUMENT BY ANY THIRD PARTY IS AT THE RISK OF THAT THIRD PARTY.

DRAWN

CHECKED

Cad ref: J:\MegaProjects\60145303\5. CAD\5.3 Working\5.3.6 Reference Design\DWG\Drawings\CRR-GEN-R-2005.dwg
Last modified: 11 May 11 - 17:16

LEAD DESIGN CONSULTANT

AECOM

AECOM Australia Pty Ltd A.B.N. 20 093 846 925

SUB-CONSULTANT

CRR-GEN-R-2005.dwg



CROSS RIVER RAIL – DETAILED FEASIBILITY PHASE

POWER DISTRIBUTION
YEERONGPILLY FEEDER STATION

Status REFERENCE DESIGN

Dwg No. CRR-GEN-R-2005

Rev. C